
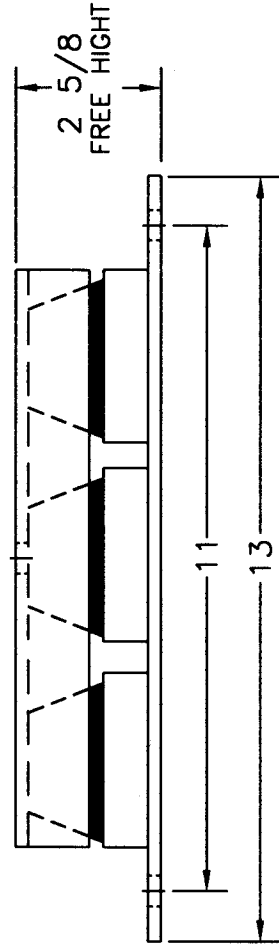


# TYPE "340S" NEOPRENE ISOLATOR

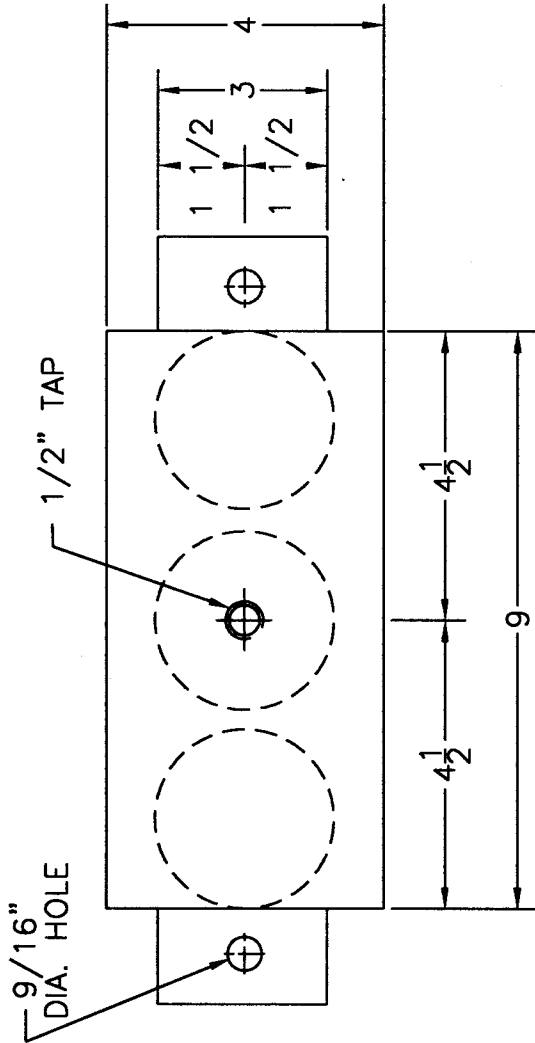

ISOLATOR TYPE	COLOR	RATED LOAD	RATED DEFL.
340S {	BLUE	1650 #	0.25"
	ORANGE	2700 #	0.25"

NOTE: ISOLATORS ARE DESIGNED FOR STATIC LOADS ONLY WITH NO LEVELING DEVICES.

## INSTALLATION INSTRUCTION

1. PLACE ISOLATORS UNDER EQUIPMENT AT POINTS OF SUPPORT.
2. BOLT ISOLATORS TO EQUIPMENT.
3. SHIM ISOLATORS TO LEVEL EQUIPMENT.



VIBRATION ELIMINATOR CO. INC.  
 15 Dixon Avenue  
 Copiague, NY 11726  
 TEL. (631)841-4000 FAX (631)841-0020

JOB : \_\_\_\_\_  
 CONTRACTOR : \_\_\_\_\_  
 P.O. NO. : \_\_\_\_\_

Dwg. No. \_\_\_\_\_