
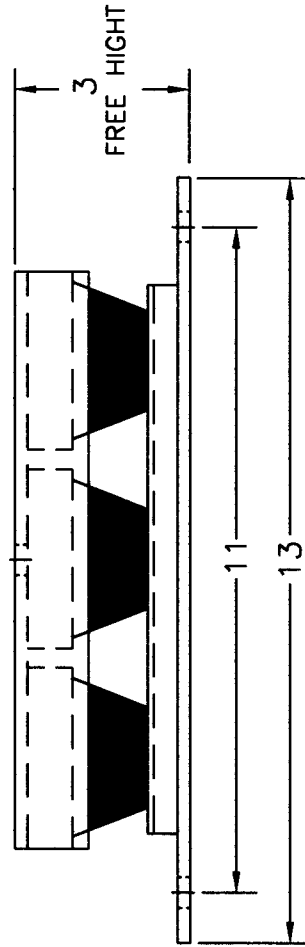


# TYPE "340TD" NEOPRENE ISOLATOR

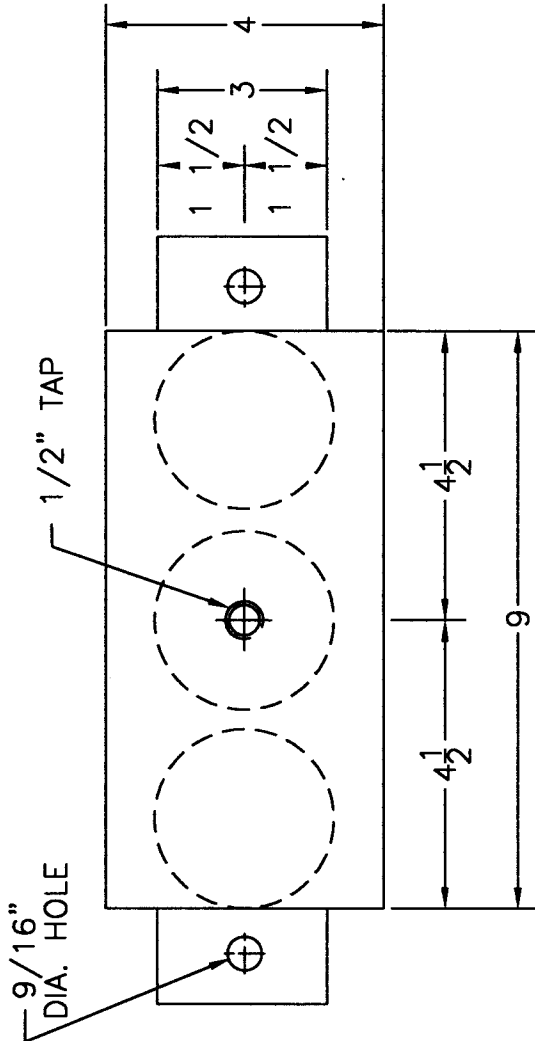


ISOLATOR TYPE	COLOR	RATED LOAD	RATED DEFL.
340TD { 3 4	BLUE	1650 #	0.5"
	ORANGE	2700 #	0.5"

NOTE: ISOLATORS ARE DESIGNED FOR STATIC LOADS ONLY WITH NO LEVELING DEVICES.

## INSTALLATION INSTRUCTION

1. PLACE ISOLATORS UNDER EQUIPMENT AT POINTS OF SUPPORT.
2. BOLT ISOLATORS TO EQUIPMENT.
3. SHIM ISOLATORS TO LEVEL EQUIPMENT.



VIBRATION ELIMINATOR CO. INC.  
15 Dixon Avenue  
Copiague, NY 11726  
TEL. (631)841-4000 FAX (631)841-0020

Dwg. No.:

JOB : \_\_\_\_\_  
CONTRACTOR : \_\_\_\_\_  
P.O. NO. : \_\_\_\_\_