


TYPE "OST" STABLE, FREE-STANDING SPRING

ISOLATOR TYPE	COLOR	RATED LOAD	RATED DEFL.	A	B	C	D	E	F		
OST4	F50	260 #	3.00"								
	F51	400 #	2.80"								
	F52	555 #	2.58"								
	F53	690 #	2.42"								
	F54	840 #	2.28"	7	6	4	1/2	8	1/4	9/16	3/4
	F55	1025 #	2.13"								
	F56	1220 #	2.00"								
	F57	1730 #	2.16"								
	F58	2340 #	2.00"								
	F59	3000 #	2.00"								
OST6	F60	40 #	2.00"								
	F61	80 #	2.00"								
	F62	120 #	2.00"								
	F63	180 #	2.00"								
	F64	250 #	2.00"								
	F65	350 #	2.00"	6	5	3	7	1/4	9/16	5/8	
	F66	500 #	2.00"								
	F67	715 #	2.00"								
	F68	945 #	2.00"								
	F69	1190 #	2.00"								


All springs are free standing and laterally stable. (Meeting a minimum of 0.8 ratio of spring diameter to compressed height.)
 All springs are designed to provide additional travel of 50% of rated load.
 All hardware zinc-electroplated.

INSTALLATION INSTRUCTIONS

- ELEVATE EQUIPMENT TO OPERATING HEIGHT AND INSERT BLOCKS TO HOLD IN THIS POSITION.
- POSITION ISOLATORS UNDER THE EQUIPMENT AT APPROPRIATE LOCATIONS BY INSERTING TOP PORTION OF LEVELING BOLT "F" INTO HOLE IN EQUIPMENT. THE ISOLATORS MUST BE INSTALLED ON A LEVEL SURFACE AND VERTICALLY ALIGNED TO PREVENT DISTORTION OF THE SPRING.
- PROCEED TO ADJUST THE ISOLATORS BY TURNING LEVELING NUT "X" COUNTER-CLOCKWISE, SEVERAL TURNS AT A TIME ALTERNATELY ON EACH ISOLATOR.
- CONTINUE TURNING ADJUSTING NUT "X" IN THIS MANNER UNTIL LOAD IS TRANSFERRED ONTO THE SPRINGS AND EQUIPMENT IS RAISED UNIFORMLY OFF THE BLOCKS. THEN REMOVE BLOCKS.
- TURN LOCK NUT "Y" ONTO LEVELING BOLT "F" AND LOCK IT SECURELY IN PLACE AGAINST THE TOP OF THE EQUIPMENT LEG OR MOUNTING FRAME.
- ISOLATORS ARE NOW PROPERLY ADJUSTED AND READY FOR THE EQUIPMENT TO BE OPERATED.

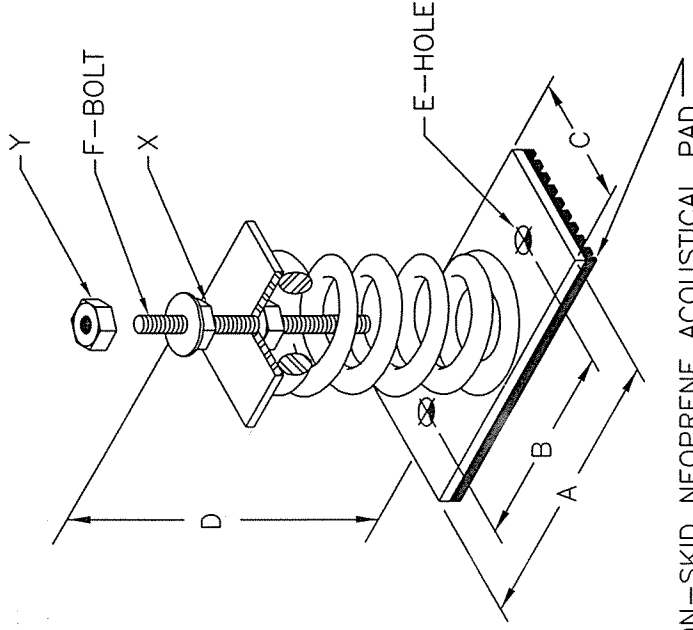

1/4" NON-SKID NEOPRENE ACOUSTICAL PAD



VIBRATION ELIMINATOR CO., INC.
 15 Dixon Avenue
 Copiague, New York 11726
 Tel. (631) 841-4000 Fax (631) 841-0020

JOB : _____
 CONTRACTOR : _____
 P.O. NO. : _____

Dwg. No.